DEMAND FOR CENTRAL HEATING AND DOMESTIC HOT WATER FROM SOLID FUEL BOILER ONLY

IN THE EVENT THAT DEMAND FROM THE GAS/OIL BOILER IS NOT REQUIRED FOR A SUBSTANTIAL LENGTH OF TIME IT WILL HAVE TO BE MANUALLY TURNED OFF.

ELECTRICAL DRAWING - REF 2/SP

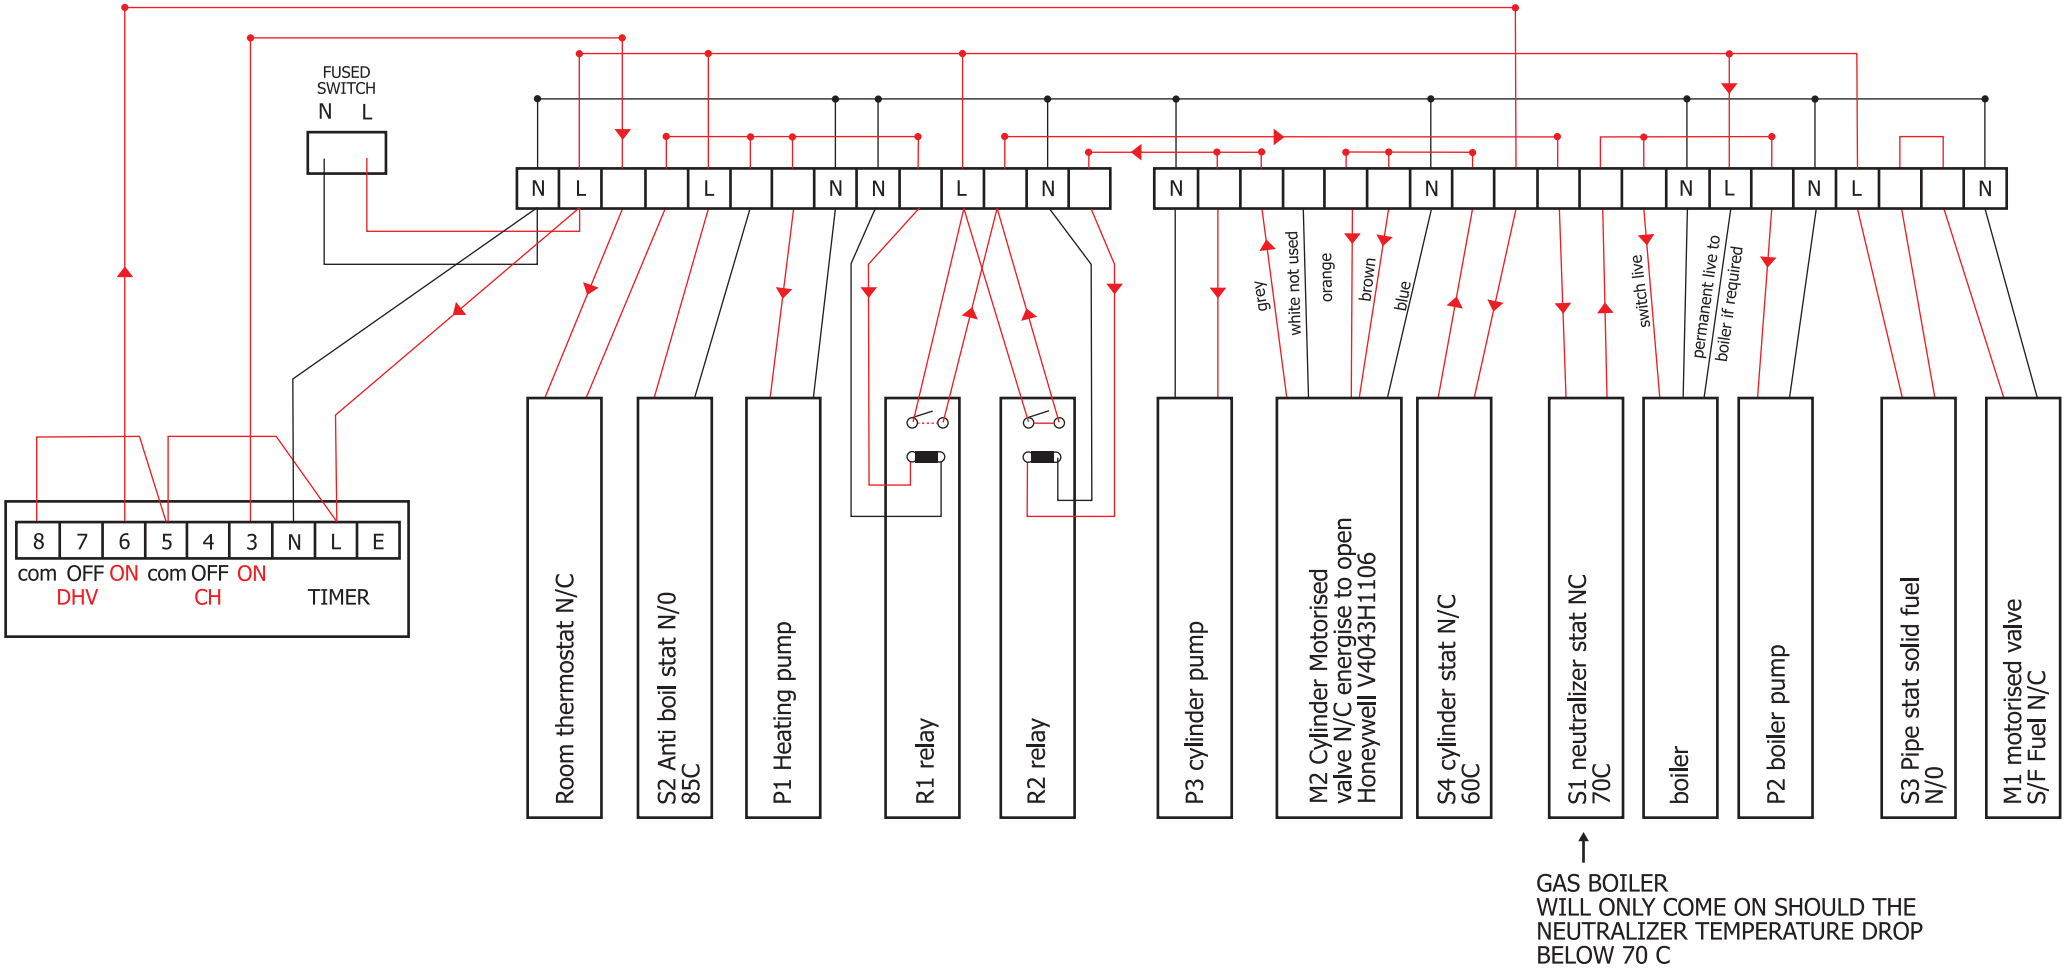

GAS BOILER
WILL ONLY COME ON SHOULD THE NEUTRALIZER TEMPERATURE DROP BELOW 70 C

db/23-02-16